


# **WM23-96**

## **SERIAL COMMUNICATION PROTOCOL**

Vers. 1 Rev. 0

January 3<sup>rd</sup>, 2006

## Index

<b>INDEX .....</b>	<b>2</b>
<b>1 SERIAL COMMUNICATION PROTOCOL.....</b>	<b>3</b>
1.1 INTRODUCTION.....	3
1.2 FUNCTIONS.....	3
1.3 MEMORY AREA .....	5
1.4 WM23-96 IDENTIFICATION CODE.....	5
<b>2 RAM VARIABLES MAP .....</b>	<b>6</b>
2.1 INSTANTANEOUS VARIABLES MAP (RAM, PAGE 1).....	6
2.2 ALARM, STATUS, MIN MAX VALUES MAP (RAM, PAGE 0).....	9
<b>3 EEPROM MAP .....</b>	<b>13</b>
3.1 MAX AND MIN EEPROM AREA .....	13
3.2 PROGRAMMING PARAMETERS .....	14
<b>4 CRC CALCULATION ALGORITHM .....</b>	<b>20</b>
<b>5 HARDWARE SPECIFICATIONS .....</b>	<b>21</b>
5.1 RS485/RS422 INTERFACE .....	21
5.2 RS232 INTERFACE .....	23

## 1 SERIAL COMMUNICATION PROTOCOL

### 1.1 INTRODUCTION

WM23-96 can be equipped with a RS485 or RS232 serial interface. The serial communication protocol, MODBUS-RTU, is the same on both interfaces. When using RS485, it is possible to connect up to 255 instruments using MODBUS protocol. When using RS232 it is only possible to connect a single instrument (multidrop feature is not available). Only one interface must be used at a time.

The command structure of the protocol allows the user to read and write from/in the  $\mu$ P RAM memory and EEPROM so that all the functions are completely transparent.

The communication parameters are fixed and in accordance with the following table:

Interface	Baud rate (bps)	Parity	Stop bit
RS232	9600	None	1
RS485	9600	None	1

The communication can be started only by the HOST unit, which sends the request frame. Each frame contains the following information:

- slave address: is a number from 1 to 255, which identifies the instrument connected to the network. Address 0 (zero) is accepted (in write frames only) by all the instruments, which will execute the relevant command but won't send any answer frame.
- command: it defines the command type (e.g. read function, write function etc.).
- data fields: these numbers define the operating parameters of the command (e.g. the address of the word, the value of the word to be written, etc.).
- CRC word: it allows detecting transmission errors that may occur. CRC calculation is carried out by the MASTER unit once it has defined address, command and data fields. When the frame is received by the SLAVE, it is stored in a temporary buffer. The CRC is calculated and then compared with the received one. If they correspond and the address is recognised by the SLAVE unit, the command is executed and an answer frame is sent.

If the CRC is not correct, the frame is discarded and no answer is sent.

### 1.2 FUNCTIONS

WM23-96 accepts the following two commands:

- Read words (code 04h)
- Write one word (code 06h)

### 1.2.1 Function 04 (read words)

#### Request frame

Address	Function	Data address		n° of words		CRC	
1 byte	1 byte	2 byte		2 byte		2 byte	
From 1 to 255	04h	MSB	LSB	MSB	LSB	MSB	LSB

**NOTE:** - The maximum number of word is 12 (24 byte).  
- The address 00 is not allowed (it generates no answer)

#### Answer frame

Address	Function	n° byte (=2 x n° word)	Values	CRC		
1 byte	1 byte	1 byte	n° byte (=2 x n° word)	2 byte		
From 1 to 255	04h	MSB	LSB	...	MSB	LSB

### 1.2.2 Function 06 (write one word)

#### Request frame

Address	Function	Data address		Value		CRC	
1 byte	1 byte	2 byte		2 byte		2 byte	
From 1 to 255	06h	MSB	LSB	MSB	LSB	MSB	LSB

#### Answer frame

Address	Function	Data address		Value		CRC	
1 byte	1 byte	2 byte		2 byte		2 byte	
From 1 to 255	06h	MSB	LSB	MSB	LSB	MSB	LSB

**NOTE:** the answer frame is an echo of the request frame, which confirm the execution of the command.

The MSB value byte of the request frame will be written in the specified address, the LSB byte in the specified address+1.

**IMPORTANT:** if the address is 00 (zero) all the instruments connected to the network will execute the command but will not send an answer frame.

### 1.3 MEMORY AREA

WM23-96 manages three different memory areas addressed as follows.

Memory area	Area		Byte reading order
Internal RAM (page 0)	0080h	00FFh	LSB, MSB
Internal RAM (page 1)	0100h	017Fh	LSB, MSB
EEPROM	0C00h	0CFFh	LSB, MSB

**NOTE:** in the following pages the following notation will be used:

- 1 int = 4 byte;
- 1 short = 2 byte;
- 1 word = 2 byte;
- 1 byte = 8 bit.

### 1.4 WM23-96 IDENTIFICATION CODE

Every Carlo Gavazzi's instrument is identified by means of a code stored in address 0Bh, in order to recognise the type of the instrument via serial communication. The WM23-96 code is 0011h.

This code can be read with the following fixed frame:

*Instrument code request frame (8 byte):*

01h	04h	00h	0Bh	00h	01h	CRC	CRC
-----	-----	-----	-----	-----	-----	-----	-----

*Instrument code answer frame (7 byte):*

01h	04h	02h	00h	11h	CRC	CRC
-----	-----	-----	-----	-----	-----	-----

## 2 RAM VARIABLES MAP

### 2.1 INSTANTANEOUS VARIABLES MAP (RAM, PAGE 1)

	ADDRESS	BYTE	VARIABLE	Type		ADDRESS	BYTE	VARIABLE	Type
1	0200	2	V L1-N	V	25	0239	3	W dmd	P
2	0202	2	V L2-N	V	26	023C	2	Hz	H
3	0204	2	V L3-N	V	27	023E	1	THA V1	D
4	0206	2	A L1	A	28	023F	1	THD V2	D
5	0208	2	A L2	A	29	0240	1	THD V3	D
6	020A	2	A L3	A	30	0241	1	THD A1	D
7	020C	3	W L1	P	31	0242	1	THD A2	D
8	020F	3	W L2	P	32	0243	1	THD A3	D
9	0212	3	W L3	P	33	0244	1	Unit V	inf
10	0215	3	var L1	P	34	0245	1	Unit A	inf
11	0218	3	var L2	P	35	0246	1	Unit P	inf
12	021B	3	var L3	P	36	0247	2	An	A
13	021E	3	VA L1	P	37	0249	2	V L1-L2	V
14	0221	3	VA L2	P	38	024B	2	V L2-L3	V
15	0224	3	VA L3	P	39	024D	2	V L3-L1	V
16	0227	1	PF L1	C	40	024F	2	VL-L $\Sigma$	V
17	0228	1	PF L2	C	41	0251	1	PF $\Sigma$ min	C
18	0229	1	PF L3	C	42	0252	1	PF L1 min	C
19	022A	2	V L-N $\Sigma$	V	43	0253	1	PF L2 min	C
20	022C	3	W $\Sigma$	P	44	0254	1	PF L3 min	C
21	022F	3	var $\Sigma$	P	45	0255	1	V asy	D
22	0232	3	VA $\Sigma$	P	46	0256	1	THD max V	D
23	0235	1	PF $\Sigma$	C	47	0257	1	THD max A	D
24	0236	3	VA dmd	P					

**NOTE:** all the variables in this table are contiguous. It is possible to read more variables at a time, up to 12 words at a time. Other maximum values are stored in the page 0 of the RAM.

#### 2.1.1 Variable format

The value of all the instantaneous variables is stored as two's complement integer value. It is possible to read the C-, D- and H-type variables with a single read command, while two read command are requested for V-, A- and P-type variables (variable and decimal point position).

The decimal point and the multiplier have to be set according to the **Unit V, Unit A, Unit P** word coding (see the following table) for voltage (V), current (A) and power (P) variables, in the position "1111" for the D-type (%) variables, "11.11" for the H-type (Hz) variables and in position "11.11" for the C-type variables (PF). The single phase PF variables are stored with a positive value if the power factor is "L" (inductive), and with a negative value if the power factor is "C" (capacitive). The variable "PF  $\Sigma$ " has neither L nor C sign indication.

#### Decimal point and multiplier coding

INF value	d.p	INF value	d.p
3	1.111	8	111.1k
4	11.11	9	1111k
5	111.1	10	11.11M
6	1111	11	111.1M
7	11.11K	12	1111M

The voltage, current and power variables format is depending on the current and voltage transformer ratios according to the following tables:


<b>CT ratio</b>	<b>Model</b>	<b>Decimal point position for A-type variables</b>
1 ÷ 10	All	1.111
11 ÷ 100	All	11.11
101 ÷ 1000	All	111.1
1001 ÷ 5000	All	1111

<b>VT ratio</b>	<b>Model</b>	<b>Decimal point position for V-type variables</b>
1.0 ÷ 10.0	100 VLL / 5A	111.1
	208 VLL / 5A	111.1
	400 VLL / 5A	111.1
	660 VLL / 5A	1111
10.1 ÷ 100.0	100 VLL / 5A	1111
	208 VLL / 5A	1111
	400 VLL / 5A	1111
	660 VLL / 5A	11.11k
100.1 ÷ 1000	100 VLL / 5A	11.11k
	208 VLL / 5A	11.11k
	400 VLL / 5A	11.11k
	660 VLL / 5A	111.1k
1000 ÷ 1999	100 VLL / 5A	111.1k
	208 VLL / 5A	111.1k
	400 VLL / 5A	111.1k
	660 VLL / 5A	1111k

<b>CT ratio x VT ratio</b>	<b>Model</b>	<b>Decimal point position for P-type variables</b>
1.0 ÷ 10.0	100 VLL / 5A	111.1
	208 VLL / 5A	111.1
	400 VLL / 5A	111.1
	660 VLL / 5A	1111
10.1 ÷ 100.0	100 VLL / 5A	1111
	208 VLL / 5A	1111
	400 VLL / 5A	1111
	660 VLL / 5A	11.11k
100.1 ÷ 1000.0	100 VLL / 5A	11.11k
	208 VLL / 5A	11.11k
	400 VLL / 5A	11.11k
	660 VLL / 5A	111.1k
1000.1 ÷ 10000.0	100 VLL / 5A	111.1k
	208 VLL / 5A	111.1k
	400 VLL / 5A	111.1k
	660 VLL / 5A	1111k

**2.1.2 Instantaneous variables reading**

**Example 1: Reading of a single variable: w1**

*Value request frame (8 byte):*

01h	04h	02h	0Ch	00h	02h	CRC	CRC
-----	-----	-----	-----	-----	-----	-----	-----

*Value answer frame (9 byte):*

01h	04h	04h	0Eh	0Eh	00h	00h	CRC	CRC
-----	-----	-----	-----	-----	-----	-----	-----	-----

*Info request frame (8 byte):*

01h	04h	02h	46h	00h	01h	CRC	CRC
-----	-----	-----	-----	-----	-----	-----	-----

*Info answer frame (frame 7 byte):*

01h	04h	02h	06h	1Fh	CRC	CRC
-----	-----	-----	-----	-----	-----	-----

Stored value:                    0E0Eh (3598 decimal)  
 Info value (P type):            06h  
 Variable value (W1):            3598 W

**Example 2: Reading of a single variable: PF1**

*Value request frame (8 byte):*

01h	04h	02h	27h	00h	01h	CRC	CRC
-----	-----	-----	-----	-----	-----	-----	-----

*Value answer frame (7 byte):*

01h	04h	02h	A9h	00h	CRC	CRC
-----	-----	-----	-----	-----	-----	-----

Stored value:                    A9h (-87 decimal)  
 Variable value (PF1):            C 0.87

## 2.2 ALARM, STATUS, MIN MAX VALUES MAP (RAM, PAGE 0)

ADDRESS	BYTE	VARIABLE	Type
00B2	1	st_in1	S
00B4	1	st_out	S
00CF	1	Reserved	
00EB	3	Wsys_max	P
00EE	3	W1_max (A1_max in AH23xxA)	P (A)
00F1	3	W2_max (A2_max in AH23xxA)	P (A)
00F4	3	W3_max (A3_max in AH23xxA)	P (A)
00F7	3	Wdmd_max	P
00FA	3	VAdmd_max	P

The contents of the S-type variables and the meaning of every byte are explained in the following paragraphs.

### 2.2.1 st\_in1: modules identification and programming enable

bit 7	bit 6	bit 5	bit 4	bit 3	bit 2	bit 1	bit 0
R	R	R	R	R	IN_CFPWM	IN_CFOUT	IN_ENPGM

- R = Reserved.
- IN\_ENPGM = Programming:
  - 0 = disabled
  - 1 = enabled
- IN\_CFOUT = Digital output module:
  - 0 = present
  - 1 = not present
- IN\_CFPWM = Analogue output module:
  - 0 = present
  - 1 = not present

### 2.2.2 st\_out: digital input and output status

bit 7	bit 6	bit 5	bit 4	Bit 3	bit 2	bit 1	bit 0
R	R	READ_IN2	READ_IN1	OUT_FISICO2	OUT_FISICO1	OUT_LOGICO2	OUT_LOGICO1

- R = Reserved.
- OUT\_LOGICO1 = Alarm 1 status (independent from "delay"):
  - 0 = Alarm OFF
  - 1 = Alarm ON
- OUT\_LOGICO2 = Alarm 2 status (independent from "delay"):
  - 0 = Alarm OFF
  - 1 = Alarm ON
- OUT\_FISICO1 = Alarm 1 status:
  - 0 = Alarm OFF
  - 1 = Alarm ON
- OUT\_FISICO2 = Alarm 2 status:
  - 0 = Alarm OFF
  - 1 = Alarm ON
- READ\_IN1 = Digital input 1 status (0 = open; 1 = closed)
- READ\_IN2 = Digital input 2 status (0 = open; 1 = closed)

**2.2.3 Reading of the instrument status**

**Example 3: reading of the “present modules+digital input status” word**

*1-word read request frame (8 byte)*

01h	04h	00h	B2h	00h	01h	CRC	CRC
-----	-----	-----	-----	-----	-----	-----	-----

*1-word read answer frame (7 byte):*

01h	04h	02h	89h	77h	CRC	CRC
-----	-----	-----	-----	-----	-----	-----

Module variable value: 89h = 10001001  
 IN\_CFPGM = 1 Programming: enabled  
 IN\_CFOUT = 0 Digital output module: present  
 IN\_CFPWM = 0 Analogue output module: present

**Example 4: Alarm status read command**

*1-word read command request frame (8 byte):*

01h	04h	00h	B4h	00h	01h	CRC	CRC
-----	-----	-----	-----	-----	-----	-----	-----

*Read command answer frame (7 byte):*

01h	04h	02h	35h	35h	CRC	CRC
-----	-----	-----	-----	-----	-----	-----

Digital output 0: NO Alarm  
 Digital output 1: Alarm OFF

**2.2.4 Write command for remote digital output**

If a digital output is set as “rem” (remote, see EEPROM map), it is possible to remotely set/reset it writing a word on address 00B4h according to the following table.

Alarm 1	Alarm 2	MSB	LSB
OFF	OFF	00h	00h
ON	OFF	01h	00h
OFF	ON	02h	00h
ON	ON	03h	00h

**Example 5: Frame to set alarm 1 = ON and alarm 2 = OFF**

*Request frame: A1 = ON and A2 = OFF (8 byte):*

01h	06h	00h	B4h	01h	00h	CRC	CRC
-----	-----	-----	-----	-----	-----	-----	-----

*Answer frame (8 byte):*

01h	06h	00h	B4h	01h	00h	CRC	CRC
-----	-----	-----	-----	-----	-----	-----	-----

**Example 6: Frame to set alarm 1 = OFF and alarm 2 = OFF**

*Request frame: A1 = OFF and A2 = OFF (8 byte):*

01h	06h	00h	B4h	00h	00h	CRC	CRC
-----	-----	-----	-----	-----	-----	-----	-----

*Answer frame (8 byte):*

01h	06h	00h	B4h	00h	00h	CRC	CRC
-----	-----	-----	-----	-----	-----	-----	-----

**NOTE:** a digital output can be used as remote control output only if the relevant “digital output type” variable stored in EEPROM is correctly set (see paragraph 3.2.9).

### 2.2.5 Maximum and minimum values reading

The maximum (powers, or currents in AH23xxA versions) and minimum (PF) values are to be read from the RAM as explained in the following examples.

#### **Example 7: Reading of two maximum values: Wdmd, VAdmd**

*Value request frame (8 byte):*

01h	04h	00h	F7h	00h	03h	CRC	CRC
-----	-----	-----	-----	-----	-----	-----	-----

*Value answer frame (9 byte):*

01h	04h	06h	D3h	07h	00h	E1h	07h	00h	CRC	CRC
-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----

*Info request frame (8 byte):*

01h	04h	02h	46h	00h	01h	CRC	CRC
-----	-----	-----	-----	-----	-----	-----	-----

*Info answer frame (frame 7 byte):*

01h	04h	02h	05h	00h	CRC	CRC
-----	-----	-----	-----	-----	-----	-----

Stored value (Wdmd max):	0007D3h (2003 decimal)
Stored value (VAdmd max):	0007E1h (2017 decimal)
Info value (P type):	05h = 111.1
Variable value (Wdmd max):	200.3 W
Variable value (VAdmd max):	201.7 VA

#### **Example 8: Reading of a minimum value: PF**

*Value request frame (8 byte):*

01h	04h	02h	51h	00h	02h	CRC	CRC
-----	-----	-----	-----	-----	-----	-----	-----

*Value answer frame (9 byte):*

01h	04h	04h	34h	34h	00h	34h	CRC	CRC
-----	-----	-----	-----	-----	-----	-----	-----	-----

PFΣ min	=	34h	=	0.52
PF1 min	=	34h	=	0.52 L
PF2 min	=	00h	=	0.00
PF3 min	=	34h	=	0.52 L

**2.2.6 Resetting maximum and minimum**

Maximum and/or minimum values are to be reset using the following fixed frames.

**Example 9: maximum values reset command**

*1-word write request command (8 byte):*

01h	06h	01h	00h	A5h	F0h	CRC	CRC
-----	-----	-----	-----	-----	-----	-----	-----

*Write answer command (8 byte):*

01h	06h	01h	00h	A5h	F0h	CRC	CRC
-----	-----	-----	-----	-----	-----	-----	-----

The reset value is 0.

**Example 10: minimum values reset command**

*1-word write request command (8 byte):*

01h	06h	01h	08h	87h	35h	CRC	CRC
-----	-----	-----	-----	-----	-----	-----	-----

*Write answer command (8 byte):*

01h	06h	01h	08h	87h	35h	CRC	CRC
-----	-----	-----	-----	-----	-----	-----	-----

The reset value is 1.00 for the system PF and 0.00 for the single-phase PF's.

**Example 11: maximum and minimum values reset command**

*1-word write request command (8 byte):*

01h	06h	00h	ECh	D4h	F0h	CRC	CRC
-----	-----	-----	-----	-----	-----	-----	-----

*Write answer command (8 byte):*

01h	06h	00h	ECh	D4h	F0h	CRC	CRC
-----	-----	-----	-----	-----	-----	-----	-----

The reset value is 0 for maximum and minimum values, 1.00 for the system PF and 0.00 for the single-phase PF's.

### 3 EEPROM MAP

The information in the EEPROM memory are stored in two different areas:

EEPROM	Area		Byte reading order
Max and min area	0C72h	0C8Fh	LSB..MSB
Programming parameters	0C90h	0CD5h	LSB..MSB

#### 3.1 MAX AND MIN EEPROM AREA

The maximum and minimum values are stored in EEPROM (only in case of power down) in the following addresses:

ADDRESS	BYTE	TYPE	DESCRIPTION	FORMAT
0C72	1	var sign	Byte including the var signs	-
0C73	1	PF sign	Byte including the PF signs (L/C)	-
0C74	1	var x PF sign	Byte incl. The var x PF signs	-
0C75	3	Wdmd max	W dmd maximum	P
0C78	3	VAdmd max	VA dmd maximum	P
0C7B	1	PF $\Sigma$ min	PF sys minimum	C
0C7C	1	PF1 min	PF L1 minimum	C
0C7D	1	PF2 min	PF L2 minimum	C
0C7E	1	PF3 min	PF L3 minimum	C
0C80	1	W sign	Byte including the Wmax signs	-
0C81	3	W $\Sigma$ max	W $\Sigma$ maximum	P
0C84	3	WL1 (AL1) max	W L1 (AL1 in AH23xxA) maximum	P (A)
0C87	3	WL2 (AL2) max	W L2 (AL2 in AH23xxA) maximum	P (A)
0C8A	3	WL3 (AL3) max	W L3 (AL3 in AH23xxA) maximum	P (A)

The storage in EEPROM of the max and min values is carried out only in case of power down. For this reason the reading of these values must be carried out on the values stored in RAM.

### 3.2 PROGRAMMING PARAMETERS

ADDRESS	BYTE	PARAMETER	DESCRIPTION
0C96	2	password	Password
0C98	2	vt_ratio	Voltage transformer ratio
0C9A	2	ct_ratio	Current transformer ratio
0C9C	4	pt_ratio	Power transformation ratio
0CA0	2	system	System type
0CA2	2	p_int	Integration period (dmd)
0CA4	2	sel_thd	Calculation THD enable
0CA6	2	sync	External synchronisation enable
0CA8	2	sel_dig1	Digital output 1 selection
0CAA	2	var_dig1	Variable associated with the alarm output 1
0CAC	2	range_dig1	Alarm 1 setpoint format
0CAE	2	dig_on1	Alarm 1 activation setpoint
0CB0	2	dig_off1	Alarm 1 deactivation setpoint
0CB2	2	rel_type1	Normally energised/de-energised output 1 (ND/NE)
0CB4	2	del_delay1	Alarm 1 delay time
0CB6	2	sel_dig2	Digital output 2 selection
0CB8	2	var_dig2	Variable associated with the alarm output 2
0CBA	2	range_dig2	Alarm 2 setpoint format
0CBC	2	dig_on2	Alarm 2 activation setpoint
0CBE	2	dig_off2	Alarm 2 deactivation setpoint
0CC0	2	rel_type2	Normally energised/de-energised output 2 (ND/NE)
0CC2	2	del_delay2	Alarm 2 delay time
0CC4	2	var_ana	Variable associated with the analogue output
0CC6	2	range_ana	Analogue output setpoint format
0CC8	2	ana_loe	Minimum value of the variable input range
0CCA	2	ana_hie	Maximum value of the variable input range
0CCC	2	ana_loa	% value of the zero of the output range, corresponding to ana_loe
0CCE	2	ana_hia	% value of the fullscale of the output range, corresponding to ana_hie
0CD0	2	address	Address of the instrument (RS485)
0CD2	2	filter_rng	Operating range of the digital filter
0CD4	2	filter_coe	Filtering coefficient

The maximum and minimum limits of the programmable parameters are listed below, together with their meaning and format.

#### 3.2.1 password

MINIMUM	MAXIMUM	FORMAT
0	1000	1111

**Note:** entering the value 782 the programming mode can be entered (reset password).

#### 3.2.2 vt\_ratio

MINIMUM	MAXIMUM	FORMAT
10	50000	111.1

### 3.2.3 ct\_ratio

MINIMUM	MAXIMUM	FORMAT
1	5000	1111

### 3.2.4 pt\_ratio

MINIMUM	MAXIMUM	FORMAT
10	100000	111.1

**Note:** pt\_ratio is the product between vt\_ratio and ct\_ratio: if ct\_ratio and/or vt\_ratio are modified via RS485, pt\_ratio must be accordingly modified (non-automatic calculation).

### 3.2.5 system

MINIMUM	MAXIMUM	FORMAT
0	1	1111

VALUE	CODE DESCRIPTION
0	3-phase with neutral
1	3-phase without neutral

### 3.2.6 p\_int

MINIMUM	MAXIMUM	FORMAT
1	30	1111 [minutes]

### 3.2.7 sel\_thd

MINIMUM	MAXIMUM	FORMAT
0	1	1111

VALUE	CODE DESCRIPTION
0	THD calculation enabled
1	THD calculation disabled

### 3.2.8 sync

MINIMUM	MAXIMUM	FORMAT
0	1	1111

VALUE	CODE DESCRIPTION
0	External synchronisation enabled
1	External synchronisation disabled

### 3.2.9 sel\_dig1(2)/sel\_ana

MINIMUM	MAXIMUM	FORMAT
0	1	1111

VALUE	CODE DESCRIPTION
0	Alarm
1	Remote

### 3.2.10 var\_dig1(2) / var\_ana :

MINIMUM	MAXIMUM	FORMAT
0	11	1111

VALUE	CODE DESCRIPTION
0	W $\Sigma$
1	VA $\Sigma$
2	Var $\Sigma$
3	W dmd
4	VA dmd
5	V L-N $\Sigma$
6	V L-L $\Sigma$
7	PF $\Sigma$
8	THDmax V
9	THDmax A
10	ASY V
11	An

### 3.2.11 range\_dig1(2)/range\_ana :

MINIMUM	MAXIMUM	FORMAT
0	3 <sup>(1)</sup>	1111

This parameter is the multiplier associated to the setpoint of the digital or analogue outputs.  
The real setpoint must be calculated as follows:

$$\text{setpoint alarm 1} = \text{dig\_on1} * 10^{\text{range\_dig1}}$$

The variable “setpoint alarm 1” is to be considered in the format of the relevant variable (in this example var\_dig1) which can be an A-, V-, P-, D- or C-type (see paragraph 2.1.1).

**Note:** <sup>(1)</sup> the maximum value of the multiplier is depending on the variable type and on the instrument model according to the following table.

Variable	Model			
	100 VLL / 5A	208 VLL / 5A	400 VLL / 5A	660 VLL / 5A
W $\Sigma$	2	3	3	2
VA $\Sigma$	2	3	3	2
VAR $\Sigma$	2	3	3	2
W dmd	2	3	3	2
VA dmd	2	3	3	2
V L-N $\Sigma$	1	1	2	1
V L-L $\Sigma$	1	2	2	1
PF $\Sigma$	0	0	0	0
THDmax V	0	0	0	0
THDmax A	0	0	0	0
ASY V	0	0	0	0
An	2	2	2	2

### 3.2.12 dig\_on1(2)/dig\_off1(2)/ana\_loe/ana\_hie

MINIMUM	MAXIMUM	FORMAT
-variable f.s.(W $\Sigma$ , var $\Sigma$ , Wdmd only) 0 (all the remaining variables)	Variable f.s.	As per range_dig1(2) or range_ana

The f.s. for each variable is depending on the instrument model, on the range parameter and on the CT and VT ratios.

If  $CT \leq 10$ ,  $VT \leq 10.0$  e  $CT*VT \leq 10.0$ , the following table is to be considered:

VARIABLE	RANGE	0	1	2	3
	MODEL	F.S.			
W $\Sigma$ , VA $\Sigma$ , var $\Sigma$ , W dmd, VA dmd	100 VLL / 5A	1999 (199.9)	1999 (1999)	1247 (12.47k)	-
	208 VLL / 5A	1999 (199.9)	1999 (1999)	1999 (19.99k)	260 (26.0k)
	400 VLL / 5A	1999 (199.9)	1999 (1999)	1999 (19.99k)	499 (49.9k)
	660 VLL / 5A	1999 (1999)	1999 (19.99k)	824 (82.4k)	-
V L-N $\Sigma$	100 VLL / 5A	1999 (199.9)	693 (693)	-	-
	208 VLL / 5A	1999 (199.9)	1450 (1450)	-	-
	400 VLL / 5A	1999 (199.9)	1999 (1999)	278 (2.78k)	-
	660 VLL / 5A	1999 (1999)	458 (4.58k)	-	-
V L-L $\Sigma$	100 VLL / 5A	1999 (199.9)	1200 (1200)	-	-
	208 VLL / 5A	1999 (199.9)	1999 (1999)	250 (2.50k)	-
	400 VLL / 5A	1999 (199.9)	1999 (1999)	480 (4.80k)	-
	660 VLL / 5A	1999 (1999)	792 (7.92k)	-	-
PF $\Sigma$	100 VLL / 5A	100 (1.00)	-	-	-
	208 VLL / 5A	100 (1.00)	-	-	-
	400 VLL / 5A	100 (1.00)	-	-	-
	660 VLL / 5A	100 (1.00)	-	-	-
THDmax V, THDmax A, ASY V	100 VLL / 5A	100 (100)	-	-	-
	208 VLL / 5A	100 (100)	-	-	-
	400 VLL / 5A	100 (100)	-	-	-
	660 VLL / 5A	100 (100)	-	-	-
An	100 VLL / 5A	1999 (1.999)	1999 (19.99)	600 (60.0)	-
	208 VLL / 5A	1999 (1.999)	1999 (19.99)	600 (60.0)	-
	400 VLL / 5A	1999 (1.999)	1999 (19.99)	600 (60.0)	-
	660 VLL / 5A	1999 (1.999)	1999 (19.99)	600 (60.0)	-

If CT is between 11 and 100, the values between brackets multiplied by 10 are valid when considering An.

If CT is between 101 and 1000, the values between brackets multiplied by 100 are valid when considering An, and so on.

If VT is between 10.1 and 100.0, the values between brackets multiplied by 10 are valid when considering VLL and VLN.

If VT is between 100.1 and 1000.0, the values between brackets multiplied by 100 are valid when considering VLL and VLN, and so on.

If CT x VT is between 10.1 e 100.0, the values between brackets multiplied by 10 are valid when considering the powers.

If CT x VT is between 100.1 e 1000.0, the values between brackets multiplied by 100 are valid when considering the powers, and so on.

### 3.2.13 rel\_type1(2)

MINIMUM	MAXIMUM	FORMAT
0	1	1111

VALUE	CODE DESCRIPTION
0	Normally De-energised
1	Normally Energised

### 3.2.14 rel\_delay1(2)

MINIMUM	MAXIMUM	FORMAT
0	255	1111 [seconds]

### 3.2.15 ana\_loa/ana\_hia

MINIMUM	MAXIMUM	FORMAT
0	1000	111.1 [%]

### 3.2.16 address

MINIMUM	MAXIMUM	FORMAT
1	255	1111

### 3.2.17 filter\_rng

MINIMUM	MAXIMUM	FORMAT
0	100	1111 [%]

Range of the variable within which the filtering is carried out. The range must be calculated as a percentage of:

- nominal value of the voltages
- base current of the currents
- product between the nominal voltage and the base current (for powers)

### 3.2.18 filter\_coe

MINIMUM	MAXIMUM	FORMAT
1	16	1111

**3.2.19 Relationship between dig\_out1(2) and the digital outputs on the modules**

In WM23-96 it is possible to insert the digital output modules (relay or open collector) in both slot C and D. The relationship between the digital output parameter diGout1 e diGout2 in the programming menu and the real digital output (in the modules) is the following.

Modules		diGout1				diGout2			
SLOT C	SLOT D	C0	C1	D0	D1	C0	C1	D0	D1
1 Relay / 1 O.C.	1 Relay / 1 O.C.		na	X	na	X	na		na
1 Relay / 1 O.C.	2 Relay / 2 O.C.		na	X		X	na		X
2 Relay / 2 O.C.	1 Relay / 1 O.C.		X	X	na	X			na
2 Relay / 2 O.C.	2 Relay / 2 O.C.		X	X		X			X

NOTA: na = not available, X = associated output.



## 5 HARDWARE SPECIFICATIONS


### 5.1 RS485/RS422 INTERFACE

General technical specifications		Note
Baud rate	9600bps	
Data format	8 data / 1 stop bit / no parity	
Address	1 to 255	
Broadcast	Yes (address 0 with function 06)	
Standard functions	04: Read function (max 12 words)	
	06: Write function (max 1 word)	
Special functions	Alarm output management	A
Answer buffer	24+5 byte	B
Writing protection	Yes	C
Identification code	17 (11h)	D
Synchr. Time-out	3 chars	E
Physical interface	MAX1482	
RX termination	Jumper between Rx+ and T terminals	
Available connections	4-wire (RS422 half duplex interface)	F
	2-wire (RS485 interface)	


**Note:**

- A. It is possible to activate/deactivate a digital output (if available) writing a word in the proper location.
- B. With a single request maximum 12 words can be read from WM23.
- C. It is possible to write in the ram and eeprom areas specified in the present protocol.
- D. See paragraph 1.4 WM23-96 identification code.
- E. It is the time that must elapse without receiving any character before starting the analysis of the received frame.
- F. RS422 interface is managed with the same protocol of the RS485 one: in this way only the half-duplex communication is allowed (TX and RX not simultaneous).

Timing characteristics for 4-wire communication	msec
T response: max answering time	500ms
T response: typical answering time	100ms
T delay1: minimum time for a new query on the same address	10ms
T delay2: minimum time for a new query on a different address	10ms
T null: maximum interruption time on the request frame	3 char

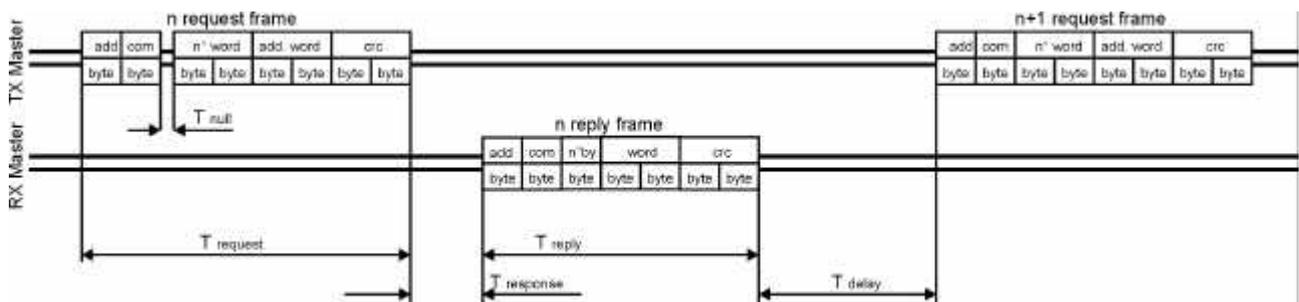

Timing characteristics for 2-wire communication	msec
T response: max answering time	500ms
T response: typical answering time	100ms
T delay1: minimum time for a new query on the same address	10ms
T delay2: minimum time for a new query on a different address	10ms
T null: maximum interruption time on the request frame	3 char

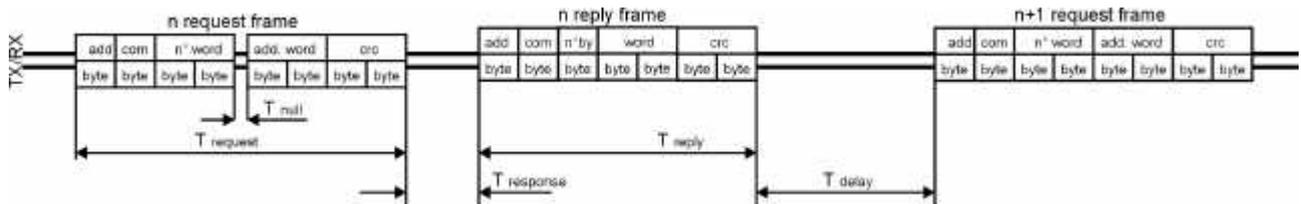

**APPLICATION NOTES**

1. If the instrument does not answer within the “max answering time”, it is necessary to repeat the query. If the instrument does not answer after 2 or 3 consecutive queries, it must be considered as not connected, faulty or having a different address. The same consideration is valid in case of CRC errors or incomplete frames.
2. By entering the programming mode (by pressing the “S” key) the communication is interrupted. Any data received during the programming mode are ignored.
3. EEPROM read and write commands must be carried out to manage “static” variables. Use them only during the instrument set-up and not during the normal measuring mode in order to avoid to extend the answer time and to limit the writing in EEPROM (max 300.000).
4. To reset the maximum and minimum values the proper fixed frames are to be used.
5. To avoid reflections or couplings between the communication wires it is suggested to terminate the last instrument of the network and of the host. If some problems persist, bias the host reception line, then the host transmission line. It is advisable to terminate the network also in case of short point to point connections.
6. If the connection is longer than 1200 m, a signal amplifier has to be used.
7. To calculate the time required to scan all the instruments of a network, the following formulae are to be used:

$$T_{request} = \frac{N^{\circ} \text{ bit}}{\text{Baud\_rate}} * 8$$

$$T_{reply} = \frac{N^{\circ} \text{ bit}}{\text{Baud\_rate}} * N^{\circ} \text{ char}$$

$$TS = T_{request} + T_{response} + T_{reply} + T_{delay1}$$

$$TA = TS * N^{\circ} \text{ reque.}$$

$$TM = (TS + T_{delay2}) * N^{\circ} \text{ instruments}$$

N° bit	10
N° char	5 + number of Words*2 (function 04); 8 (function 06)
N° word	Number of words to be read in the same request
TS	Reading execution time
Tdelay1	Minimum time for a new query on the same address
TA	Instrument data acquisition time
TM	Total network scanning time
N° instruments	Number of instruments connected in the network
Tdelay2	Minimum time for a new query on a different address


**5.2 RS232 INTERFACE**

General technical specifications		Note
Baud rate	9600 bps	
Data format	8 data / 1 stop bit / no parity	
Address	1 to 255	

9-pole female RS232 connector		Note
Pin 1	Not used	
Pin 2	TX	To be connected to the RX terminal of the PC COM
Pin 3	RX	To be connected to the TX terminal of the PC COM
Pin 4	Not used	
Pin 5	GND	To be connected to the GND terminal of the PC COM
Pin 6	Not used	
Pin 7	Not used	
Pin 8	Not used	
Pin 9	Not used	

**Note:** to connect WM23 with a PC use a serial cable with “pin to pin” connections.

Timing characteristics for RS232 communication	msec
T response: max answering time	500ms
T response: typical answering time	100ms
T delay: minimum time for a new query	10ms
T null: maximum interruption time on the request frame	10ms

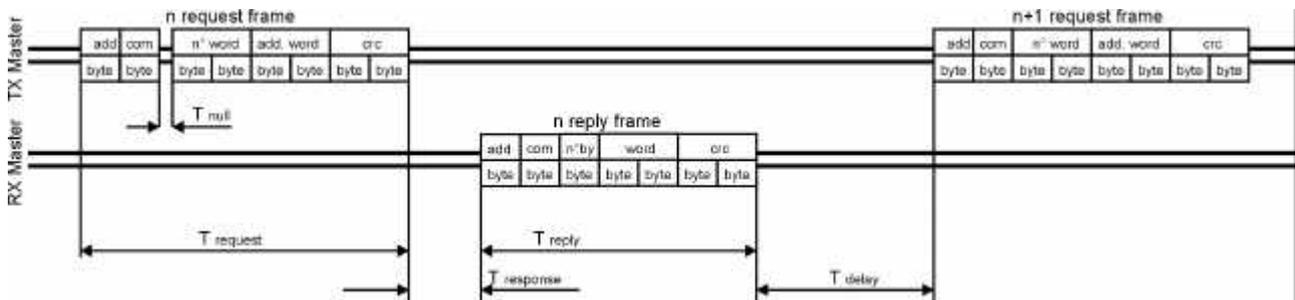

<b>CARLO GAVAZZI CONTROLS</b>	<b>SERIAL COMMUNICATION PROTOCOL</b>	Page 24			
	WM23-96				
	V1 R0				

**APPLICATION NOTES**

1. If the instrument does not answer within the “max answering time”, it is necessary to repeat the query. If the instrument does not answer after 2 or 3 consecutive queries, it must be considered as not connected, faulty or having a different address. The same consideration is valid in case of CRC errors or incomplete frames.
2. By entering the programming mode (by pressing the “S” key) the communication is interrupted. Any data received during the programming mode are ignored.
3. EEPROM read and write commands must be carried out to manage “static” variables. Use them only during the instrument set-up and not during the normal measuring mode in order to avoid to extend the answer time and to limit the writing in EEPROM (max 300.000).
4. Control lines are not managed.