



## Series 19MJ00

Mechanical Joint Restraint for 4 through 12 inch C900 PVC

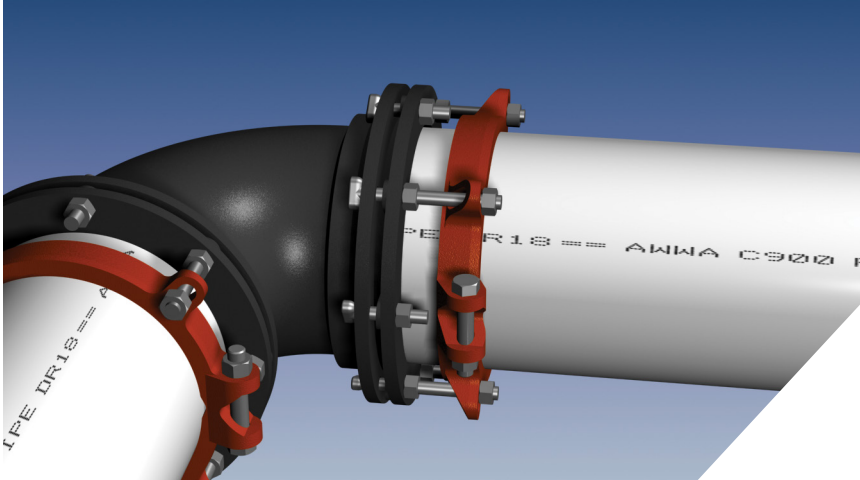


## Series 1900

Restraint Harness for 4 through 12 inch C900 PVC

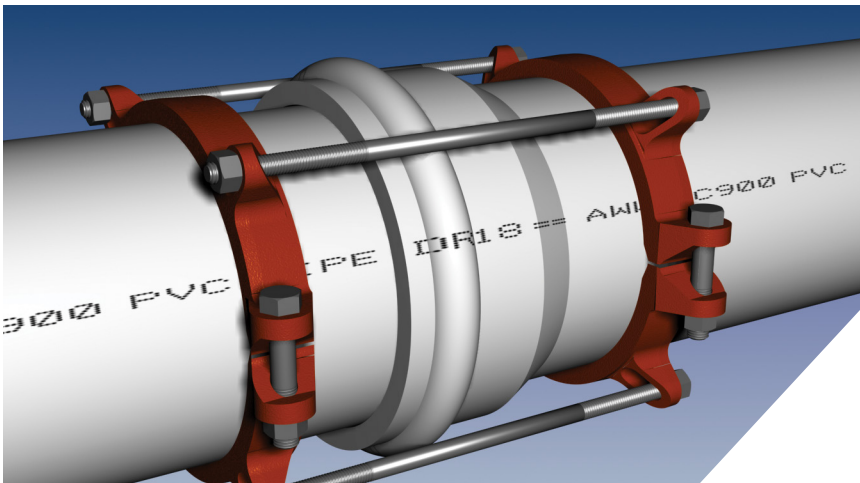

## Series 19PF00

Restraint at Ductile Iron Fittings for 4 through 12 inch C900 PVC

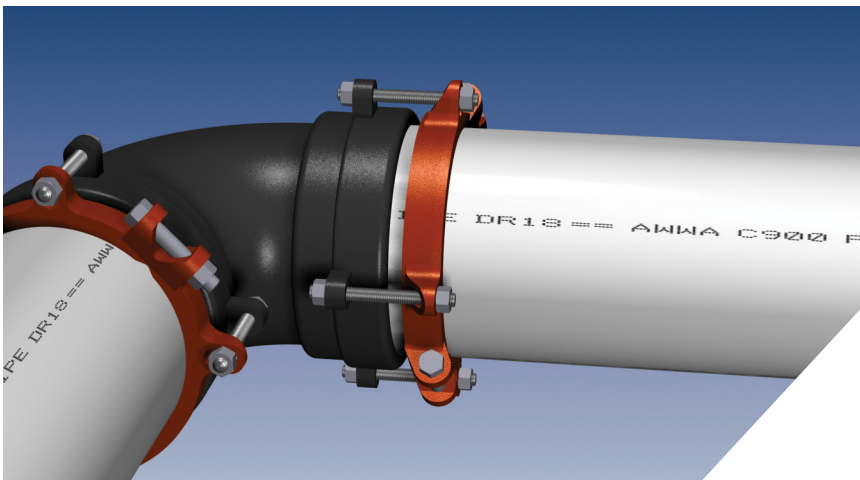

### Features and Applications:

- For use on AWWA C900 PVC
- Sizes 4 inch through 12 inch
- Rated to the Full Pressure of the Pipe
- Minimum 2 to 1 Safety Factor
- Split Serrated Restraint Rings for ease of installation
- **MEGA-BOND®** Restraint Coating System
- Constructed of ASTM A536 ductile iron

For use on water and wastewater pipelines subject to hydrostatic pressure and tested in accordance with either AWWA C600 or ASTM D2774.

### Sample Specification

Restraint for AWWA C900 PVC Pipe shall consist of the following: The restraint shall be manufactured of ductile iron conforming to ASTM A536. The restraint devices shall be coated with MEGA-BOND. (For complete specifications on MEGA-BOND visit [www.ebaa.com](http://www.ebaa.com).) The combination of the restraint(s) and fasteners shall have a pressure rating as shown in the submittal reference tables withing this brochure. The restraint shall have a two to one safety factor.

### Restraint at Ductile Iron Fittings:

A split serrated ring shall be used to grip the plain-end of the pipe, a sufficient number of bolts shall connect the restraint ring to the ductile iron fitting. The restraint for mechanical joint fittings shall be the Series 19MJ00. The restraint for push-on fittings with restraining ears shall be the 19PF00.

### Restraint Harness:

A split serrated ring shall be used to grip the plain-end of the pipe. A split serrated ring shall also be used to grip the barrel of the pipe behind the bell, and a sufficient number of bolts shall be used to connect the restraint rings. The combination shall be the Series 1900.


All Series manufactured by EBAA Iron, Inc., or approved equal.



# Series 19MJ00 Submittal Reference Drawing

EBAA IRON

MADE IN USA

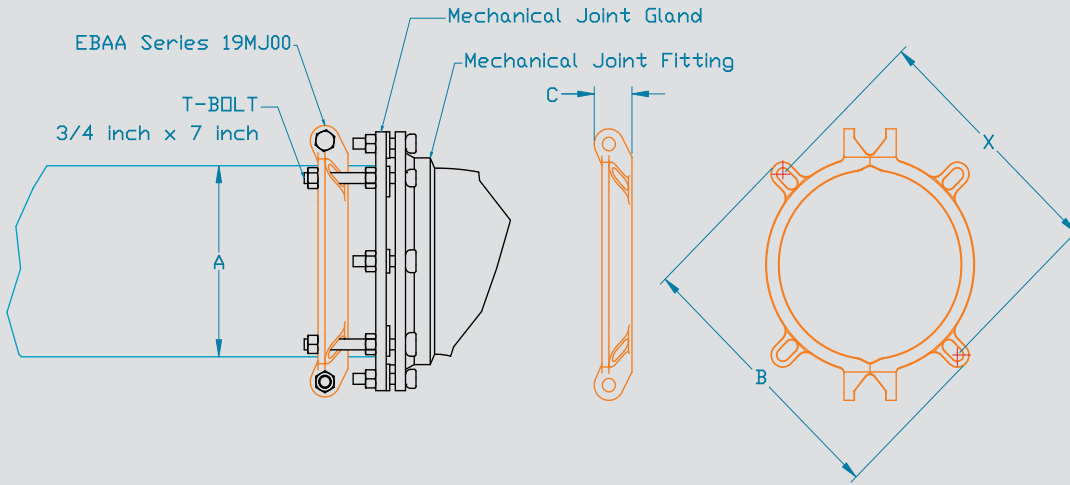

## Pressure Rating\*

Nominal Pipe Size	Series Number	Pressure Rating*			Approximate Shipping Weight	A	B	C	**	X
		DR14 PSI	DR18 PSI	DR25 PSI		Pipe O.D.	Max. Restraint O.D. (casing clearance)	Restraint Ring Width	Thrust Bolt Quantity	Thrust Bolt Circle (Min. - Max.)
4	19MJ04	305	235	165	11.03	4.80	9.20	2.04	2	7.5
6	19MJ06	305	235	165	13.33	6.90	11.20	2.04	2	9.5
8	19MJ08	305	235	165	17.53	9.05	14.70	2.04	4	11.32 - 12.99
10	19MJ10	305	235	165	34.58	11.10	16.61	2.70	4	14.00 - 14.94
12	19MJ12	305	235	165	40.38	13.20	19.33	2.70	4	15.94 - 17.66


NOTE: Dimensions are in inches ( $\pm 1\%$ ) and are subject to change without notice.

\* Please refer to the FM APPROVAL GUIDE for FM pressure ratings for this product.

\*\* Derate pressure rating if not all connecting bolts were used.

## Installation Instructions


1. Identify the pipe. The Series 19MJ00 is designed for restraining C900 PVC and C909 PVCO pipe at ductile iron Mechanical Joint (MJ) fittings with MJ glands (supplied by others). The restraint is a split, serrated ring installed behind the MJ gland. The 19MJ00 utilizes longer t-Bolts than the standard MJ t-Bolt lengths to facilitate the restraint position.

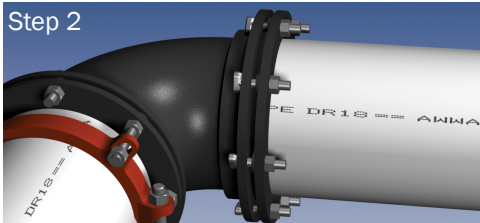

2. Set aside the split restraint and longer bolts and install the MJ gland per AWWA C600. The bolt torques for 4 inch through 12 is 75-90 ft-lbs. The use of a torque-indicating wrench will facilitate the procedure.




3. Using a longer bolt as a gauge, place one half of the restraint onto the pipe so the bolt holes of the restraint and the MJ gland align. Allow enough room on the longer bolts to fully engage the nuts with several threads showing.

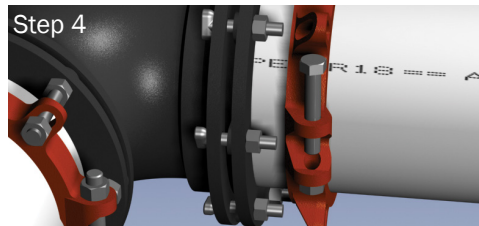

4. Install the second half of the restraint to align with the first. Tapping each half into place may be necessary. Before installing the side bolts double check the position by using the longer bolts as gauges. Make sure the ID of the restraint is touching the pipe. Side bolts are to be evenly tightened to 120 ft-lbs of torque (70 ft-lbs on 4 inch and 6 inch). A torque indicating wrench will help facilitate this.




5. Each of the longer bolts should have two nuts: one to tighten against the MJ gland and one to snug up against the restraint ring with a few threads showing. One at a time, remove a shorter bolt that aligns with the restraint bolt hole and replace with the longer bolt, remembering to "run" one nut up to engage against the MJ gland. This nut should be to the same torque as the original one removed (see step 2 for torque values). Do this for all remaining bolts holes of the restraint.

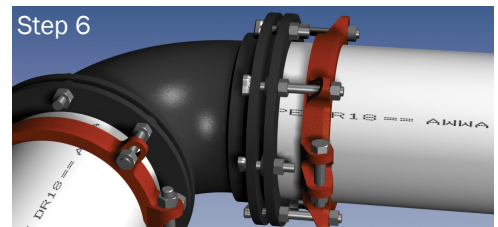

6. Once all bolts are in place and the MJ gland nuts have been retightened to torque, put the remaining nuts on the bolt behind the restraint. Hand tighten the nuts behind the restraint. Do not over tighten the nuts behind the restraint to move the plain-end of the pipe further into the joint.

# Series 1900 Submittal Reference Drawing

EBAA IRON

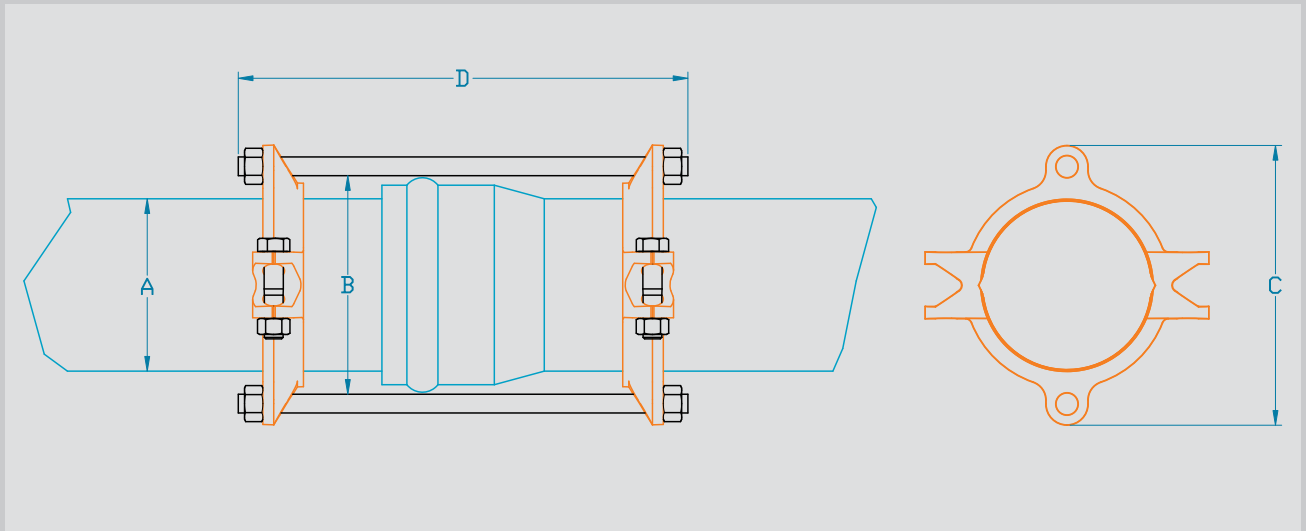


MADE IN USA

Nominal Pipe Size	Series Number	Approximate Shipping Weight	Pressure Rating (PSI)*			A	B	C	D	Thrust Bolt (Number-Size)
			DR14 PSI	DR18 PSI	DR25 PSI	Pipe O.D.	Maximum Bell O.D. Cleared	Max. Restraint O.D. (Casing Clearance)	Overall Length	
4	1904	21.52	305	235	165	4.80	6.625	9.20	13	2 - 3/4 x 13
6	1906	27.14	305	235	165	6.90	8.625	11.20	18	2 - 3/4 x 18
8	1908	39.66	305	235	165	9.05	12.12	14.70	18	4 - 3/4 x 18
10	1910	71.82	305	235	165	11.10	14.07	16.61	22	4 - 3/4 x 22
12	1912	82.62	305	235	165	13.20	16.79	19.33	22	4 - 3/4 x 22


NOTE: Dimensions are in inches (± 1%) and are subject to change without notice.  
\* Please refer to the FM APPROVAL GUIDE for FM pressure ratings for this product.

## Installation Instructions

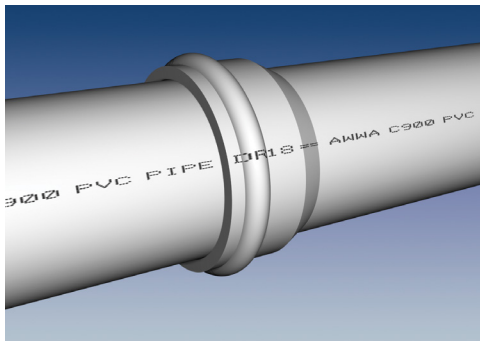


The Series 1900 is designed for restraining push-on PVC pipe bells. It has a split, serrated restraint ring on the spigot and a split serrated ring behind the bell.


1. Assemble the push-on joint per the pipe manufacturer's instructions.

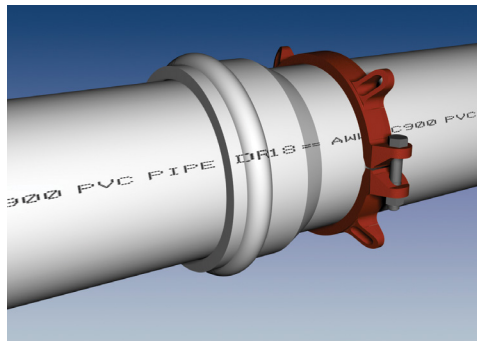


2. Install both halves of the serrated ring around the pipe behind the bell, tapping each half into place. Make sure that the complete ID of the ring is touching the pipe before installing the side bolts. Install the side bolts and tighten evenly to 120 ft-lbs. of torque. (70 ft-lbs on 4 inch and 6 inch)

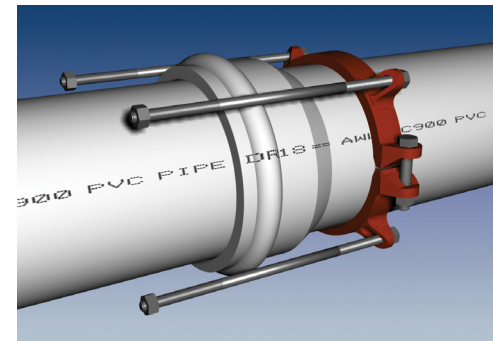


3. Remove the side bolts from the second serrated restraint ring. Use the Thrust Bolts to determine the proper location of the restraint ring on the spigot. Allow enough room on the thrust bolt to fully engage the nuts.

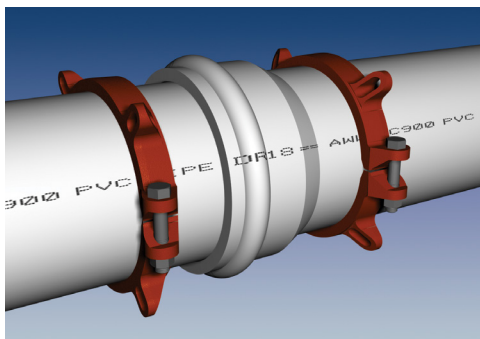

4. Install both halves of the restraint ring at the proper location, tapping each half into place. Make sure that the complete ID of the ring is touching the pipe before installing the side bolts. Tighten the side bolts evenly to 120 ft-lbs. (70 ft-lbs on 4" and 6")

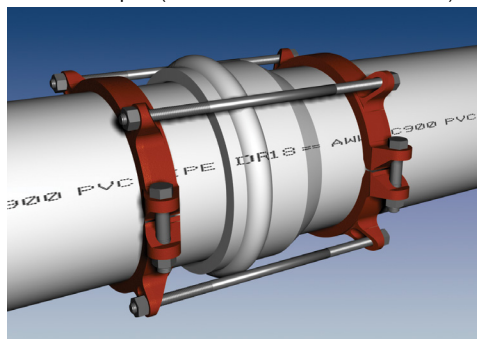

5. Place nuts on the thrust bolts and hand tighten until they are snug. Allow enough room on the thrust bolts to fully engage the nuts. Do not tighten these bolts enough to force the spigot further into the bell of the joint.




Members of...  
**AFS**  
AMERICAN FOUNDRY SOCIETY

**EBAA IRON Sales, Inc.**  
P.O. Box 857, Eastland, TX 76448  
Tel: (254) 629-1731  
Fax: (254) 629-8931  
(800) 433-1716 within US and Canada  
contact@ebaa.com  
www.ebaa.com

# Series 19PF00 Submittal Reference Drawing

EBAA IRON

MADE IN USA



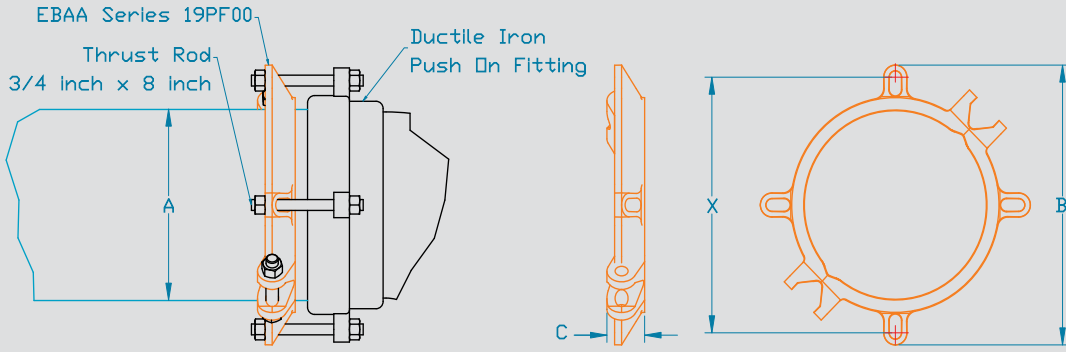


## Pressure Rating\*

Nominal Pipe Size	Series Number	Pressure Rating*			Approximate Shipping Weight	A	B	C	**	X
		DR14 PSI	DR18 PSI	DR25 PSI		Pipe O.D.	Max. Restraint O.D. (casing clearance)	Restraint Ring Width	Thrust Bolt Quantity	Thrust Bolt Circle (Min. - Max.)
4	19PF04	305	235	165	11.03	4.80	9.20	2.04	2	7.5
6	19PF06	305	235	165	13.33	6.90	11.20	2.04	2	9.5
8	19PF08	305	235	165	17.53	9.05	14.70	2.04	4	11.32 - 12.99
10	19PF10	305	235	165	34.58	11.10	16.61	2.70	4	14.00 - 14.94
12	19PF12	305	235	165	40.38	13.20	19.33	2.70	4	15.94 - 17.66

NOTE: Dimensions are in inches (± 1%) and are subject to change without notice.  
 \* Please refer to the FM APPROVAL GUIDE for FM pressure ratings for this product.  
 \*\*Derate pressure rating if not all connecting bolts were used.

## Installation Instructions

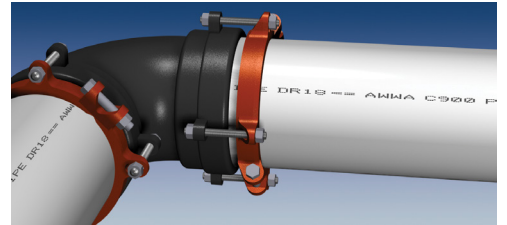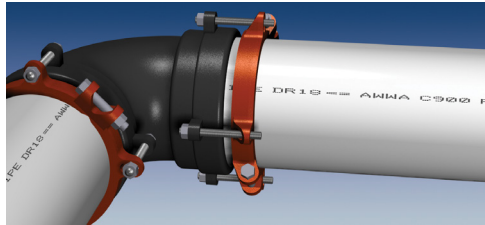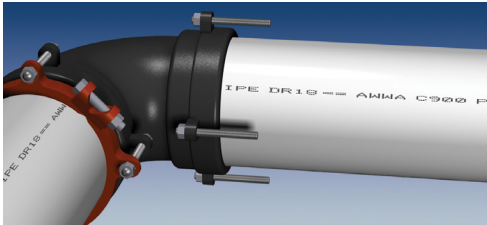


The Series 19PF00 is designed for restraining C900 PVC pipe at ductile iron fittings supplied with restraining ears. The restraint has a split, serrated restraint ring on the spigot and attaches to the fitting with connecting thrust rods.

1. Assemble joint per the pipe and fitting manufacturer's instructions.

2. Using the connecting thrust rods to determine the proper restraint location, install both halves of the restraint by tapping them into place. Allow enough room on the connecting thrust rods to fully engage the nuts with several threads showing. Make sure the ID of the restraint is touching the pipe before installing and tightening of side bolts. Side bolts are to be evenly tightened to 120 ft-lbs of torque (70 ft-lbs on 4 inch and 6 inch). A torque indicating wrench will help facilitate this.

3. Tighten the connecting thrust rods until snug; do not over tighten connecting thrust rods as to move the spigot further into the joint.



## EBAA IRON Sales, Inc.

P.O. Box 857, Eastland, TX 76448

Tel: (254) 629-1731

Fax: (254) 629-8931

(800) 433-1716 within US and Canada

contact@ebaa.com

www.ebaa.com