




SPLIT-CORE CURRENT TRANSFORMER

JSXXFL-XXX-333mV series



HOW TO USE

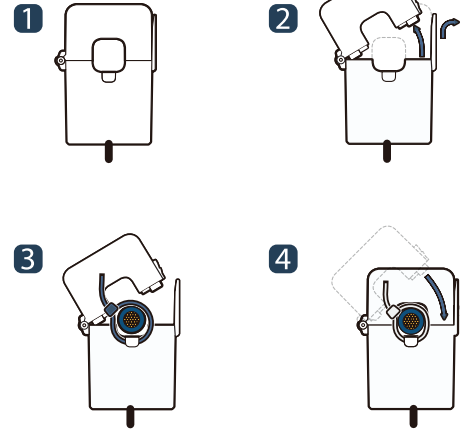

JS series of split-core current transformer offers 333mV at secondary from sensed primary current. Without using secondary CT inside of meter, users directly connect JS series to a meter for high accuracy metering application. It enables one meter to be adopted for various current rating by only changing primary CT so it makes compact design meter and reduces developing cost. Also, over-voltage protection circuit is included to offer safe, fast and cost effective installation.

APPLICATIONS

- Power meter
- Switchgear
- Distributed measurement systems
- General Sets
- Control panels

FEATURES

- PC spring, secure locking hinge, one-touch structure make easy to install to the existent equipments such as a power distribution boards.
- Isolated plastic case recognized according to UL94-V0
- UL / EN 61010 - 1 certified

BENEFITS

- Small-size, light-weight
- Simple Installation
- Over-Voltage protection circuit is installed.

NOTICE

- If you impact the core surface, internal core material could be damaged.
- Customizing output lead wire

SPECIFICATION

Accuracy	Class 1.0
System Voltage	720V(0.72kV)
Overload withstand	1.2 times rated current continuously
Compliant with	IEC/EN61869-2 & IEC61010-1
Operating Temperature Range	-20°C to 55°C
Relative Humidity	0-85% non-condensing
Test Voltage	3kV for 1 minute
Frequency Range	50/60Hz
Protection Level	3.0V0-P
Insulation Category	CAT II or CAT III 600VAC



CURRENT TRANSFORMER RATIOS

How to Order / Model Reference

eg **J S 1 0 F L** | **0 0 0** | **3 3 3 mV**

Model **J S 1 0 F L**

Primary Current

Select code from ratio table

Secondary Voltage

333mV

3 3 3 mV

Current Transformer Ratios

Primary Current (A)	Metering Burden(VA)				Code
	cl. 0.2S	cl. 0.5S	cl. 1		
	cl. 0.3	cl. 0.6	cl. 1.2		
5			0.05		005
10			0.05		010
20			0.05		020
25			0.05		025
30			0.05		030
50			0.05		050
75			0.05		075

333mV Secondary

Accuracy conforms to IEC 61869-2 & IEEE/ANSI C57.13 meets the measuring range from 1 to 120 % of I_n

How to Order / Model Reference

eg **J S 1 6 F L** | **0 0 0** | **3 3 3 mV**

Model **J S 1 6 F L**

Primary Current

Select code from ratio table

Secondary Voltage

333mV

3 3 3 mV

Current Transformer Ratios

Primary Current (A)	Metering Burden(VA)				Code
	cl. 0.2S	cl. 0.5S	cl. 1		
	cl. 0.3	cl. 0.6	cl. 1.2		
70			0.05		070
100			0.05		100

333mV Secondary

Accuracy conforms to IEC 61869-2 & IEEE/ANSI C57.13 meets the measuring range from 1 to 120 % of I_n

How to Order / Model Reference

eg **J S 2 4 F L** | **0 0 0** | **3 3 3 mV**

Model **J S 2 4 F L**

Primary Current

Select code from ratio table

Secondary Voltage

333mV

3 3 3 mV




Current Transformer Ratios

Primary Current (A)	Metering Burden(VA)				Code
	cl. 0.2S	cl. 0.5S	cl. 1		
	cl. 0.3	cl. 0.6	cl. 1.2		
5			0.05		005
10			0.05		010
30			0.05		030
50			0.05		050
70			0.05		070
100			0.05		100
150			0.05		150
200			0.05		200

333mV Secondary

Accuracy conforms to IEC 61869-2 & IEEE/ANSI C57.13 meets the measuring range from 1 to 120 % of I_n

APPLICATIONS / DIMENSIONS

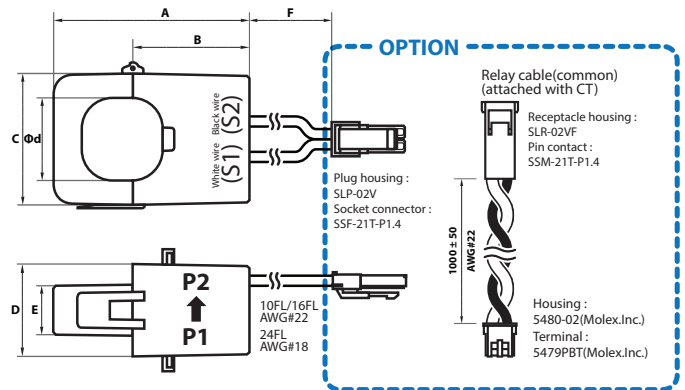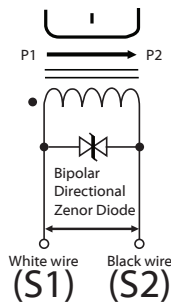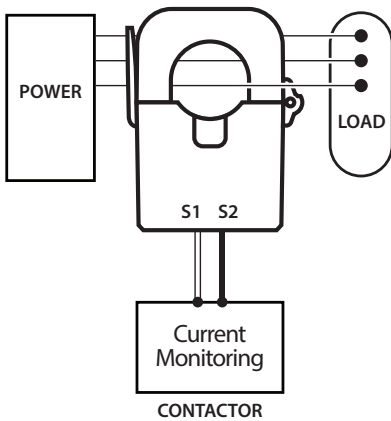

Unit : mm

Model	A	B	C	D	E	F	Ød
JS10FL	40.5	23	23.7	26.6	14.5	150±20	10
JS16FL	45	26	30	31.6	18.8	150±20	16
JS24FL	65	37.5	45	33.7	21.1	200±20	24