



SCREW COVER  
SET SCREW LOCK

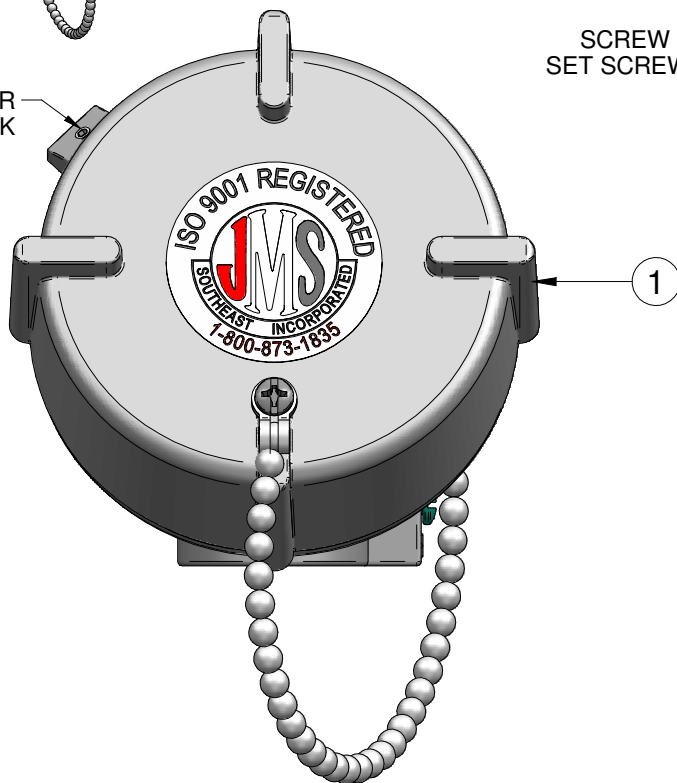

IECEEx / ATEX II 2GD  
Ex d IIC Gb  
Ex tb IIIC Db IP66  
Ta = -20°C to 125°C

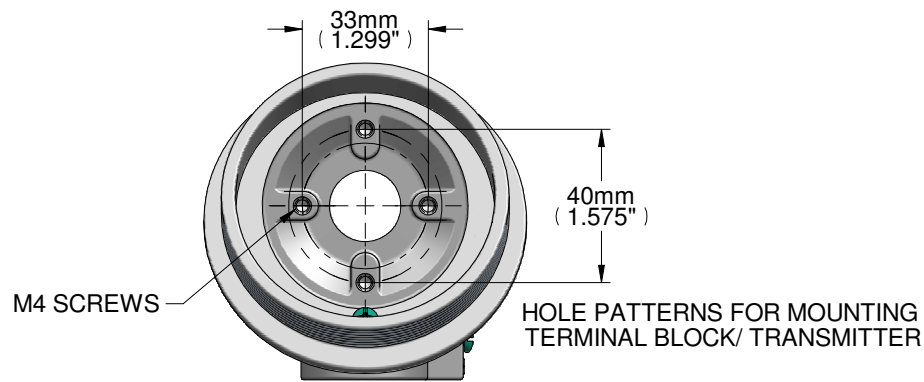


M4 SCREWS

HOLE PATTERNS FOR MOUNTING  
TERMINAL BLOCK/ TRANSMITTER

#### DESCRIPTION

1 HEAD, EXPLOSION PROOF, NEMA 4X IP 68, 316 STAINLESS STEEL, SCREW COVERED CAP & CHAIN,, 3/4" X 1/2" FNPT, BUNA N O-RING

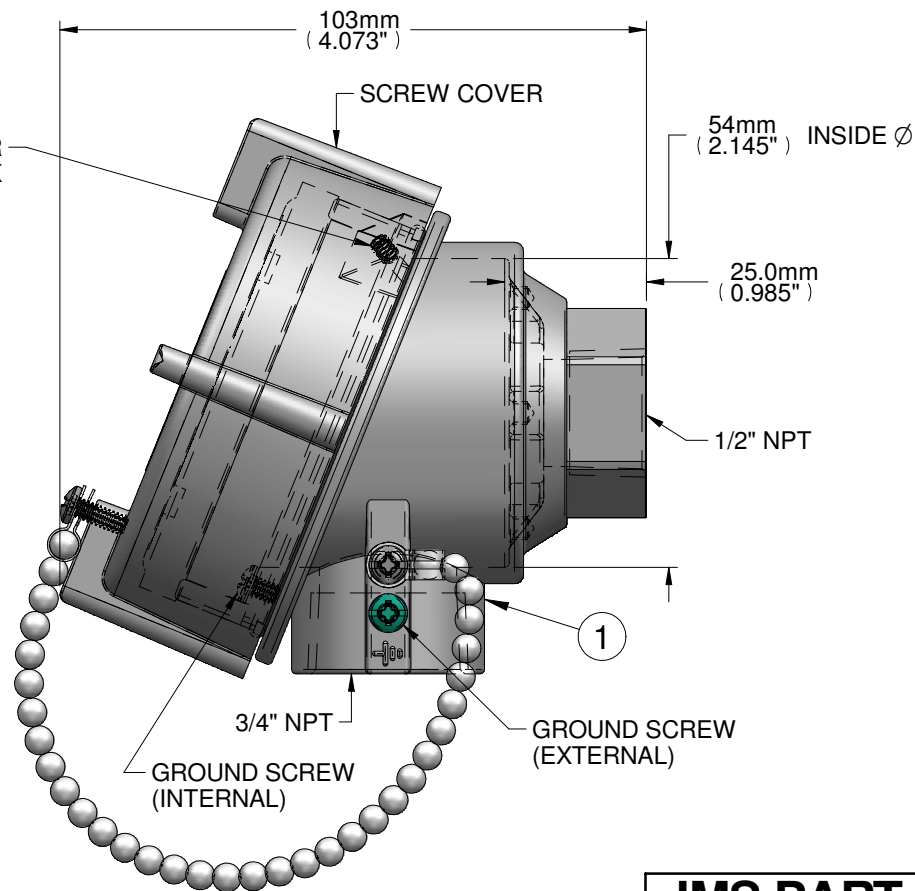

103mm  
(4.073")

SCREW COVER

SCREW COVER  
SET SCREW LOCK

54mm  
(2.145") INSIDE Ø

25.0mm  
(0.985")

1/2" NPT

3/4" NPT

GROUND SCREW  
(INTERNAL)

GROUND SCREW  
(EXTERNAL)

**JMS PART #**  
**6ISSATEX**

JMS SOUTHEAST INCORPORATED CERTIFIES THIS DRAWING IS IN ACCORDANCE WITH JMS SOUTHEAST INCORPORATED ENGINEERING SPECIFICATIONS AND ACCURATELY REPRESENTS THE EQUIPMENT FURNISHED. THIS DRAWING IS THE SOLE PROPERTY OF JMS SE, AND MUST BE RETURNED UPON DEMAND IT MAY NOT BE REPRODUCED NOR THE INFORMATION CONTAINED THEREIN USED WITHOUT THE WRITTEN PERMISSION OF JMS SOUTHEAST INCORPORATED

Company Name:

**JMS-SE HEADS**

Reference Data:

Drawing #:

#### TOLERANCE TABLE:

PROBE (L): 0-48" ±1/8"  
48"-144" ±1/4"  
144" + -1"/+2"  
WIRE (L): <24" -1/2"/+1"  
>24" -1/2"/+2"  
PROT. TUBE (P&U): ±1/4"  
FRACTIONAL DIM: ±1/8"  
DECIMAL DIM:  
XX ±0.10"  
XXX ±0.010"  
XXXX ±0.005"  
UNLESS STATED OTHERWISE

Approvals


Initials

Date

Drafting

Engineering

Second



**JMS SOUTHEAST, INC.**  
Temperature Measurement  
105 Temperature Lane  
Statesville, North Carolina 28677  
Phone: (704) 873-1835  
Fax: (704) 878-6166  
www.jms-se.com  
Email: sensors@jms-se.com

REV. 4-10-2009